


NOTES:

1. MANHOLE COVER SHALL BE DESIGNED FOR A.A.S.H.O. H-20 LOADING.
2. CAST IRON SHALL HAVE MINIMUM TENSILE STRENGTH OF 30,000 LBS PER SQUARE INCH.
3. CLEANOUTS SHALL BE INSTALLED AT THE END OF THE SEWER MAIN IF WITHIN 200 FEET OF A MANHOLE, AND AS APPROVED BY DEPARTMENT.
4. LETTERING SHALL BE CAST IN COVER.

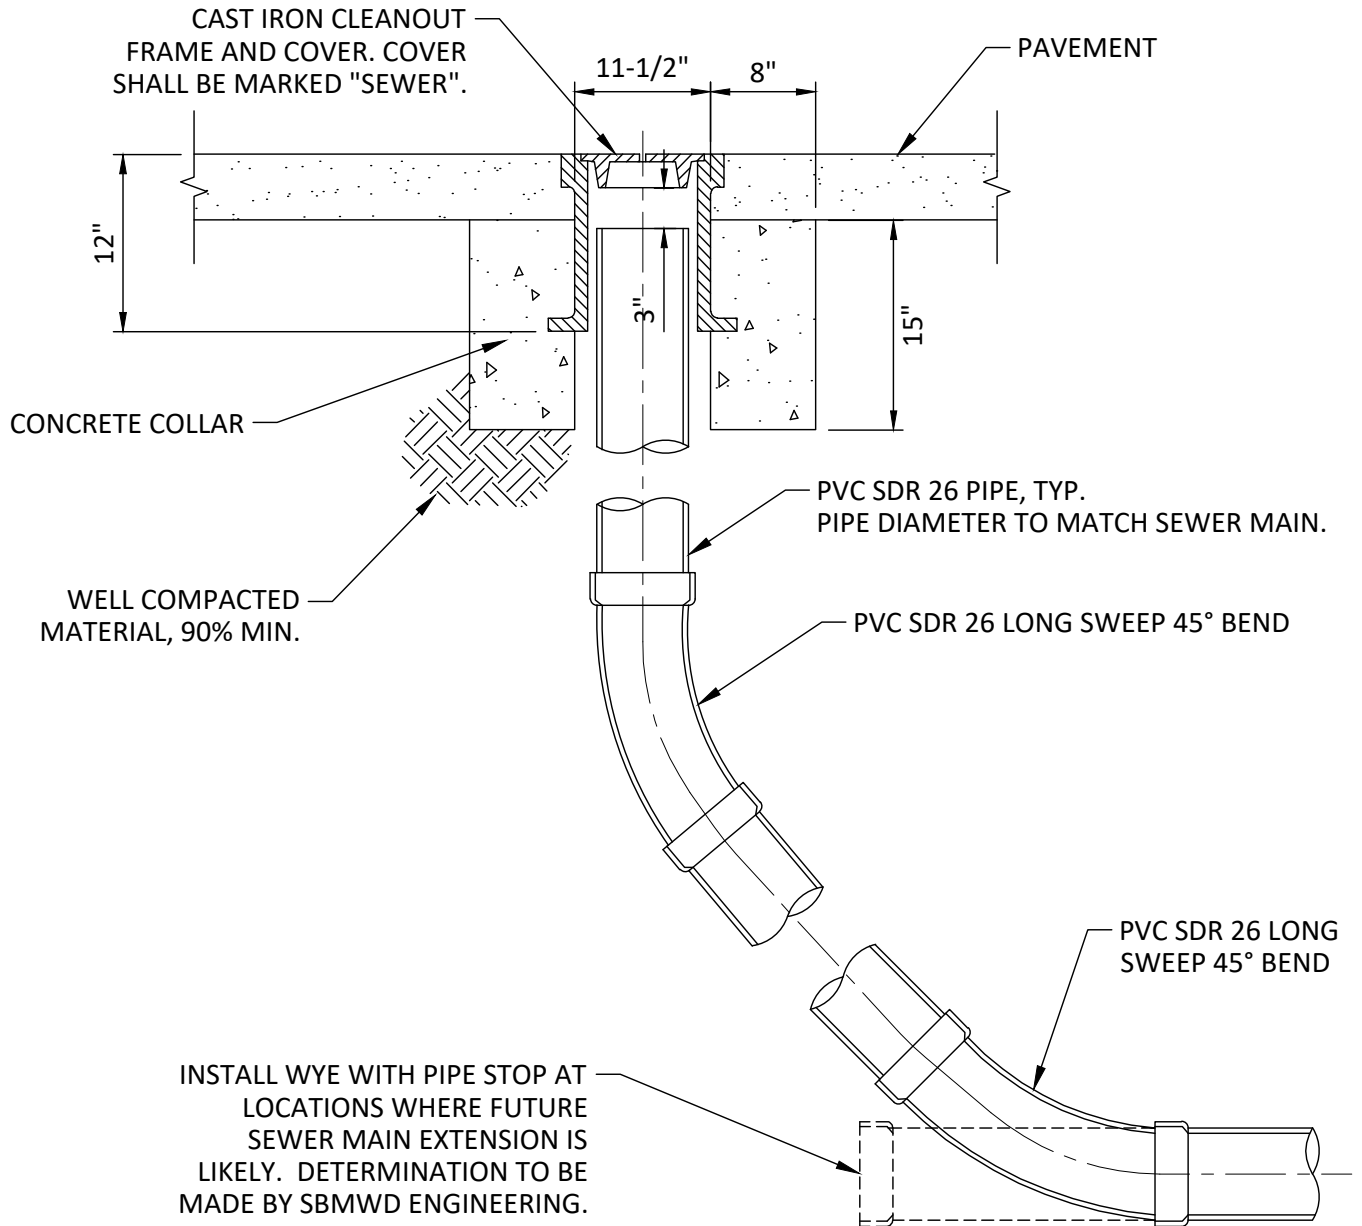

N.T.S.

REVISION	DATE	CITY OF SAN BERNARDINO MUNICIPAL WATER DEPARTMENT		DRAWING NUMBER
		STANDARD CLEANOUT		SBMWD
				S.303
DRAWN BY: JRVS		APPROVED 		DATE 07/03/2019
SUPERVISED: AC		WARREN HUANG, P.E. RCE 49208		