


NOTES:

1. BACKFILL AND PAVEMENT REPLACEMENT SHALL BE PER SBMWD STD. DWG. W5.1.
2. REMOVE ON-SITE CLEAN OUT, IF ANY. INSTALL CONCRETE END PLUGS ON BOTH ENDS OF SEWER LATERAL ADJACENT TO CLEAN OUT.
3. IF THE CONNECTION TO THE MAIN IS A TAP OR SADDLE, IT SHALL BE REMOVED AND A FULL CIRCLE REPAIR CLAMP INSTALLED.
4. PLUGS SHALL BE CEMENTED IN WITH CEMENT MORTAR, AND SHALL BE NEOPRENE STOPPER OR APPROVED EQUAL.
5. SEWER CAP SHALL BE FLEXIBLE PVC MATERIAL FASTENED BY 300 SERIES STAINLESS STEEL CLAMPS.
6. REMOVE AND DISPOSE OF EXCESS MATERIALS IN ACCORDANCE WITH LOCAL, STATE, AND FEDERAL REGULATIONS.

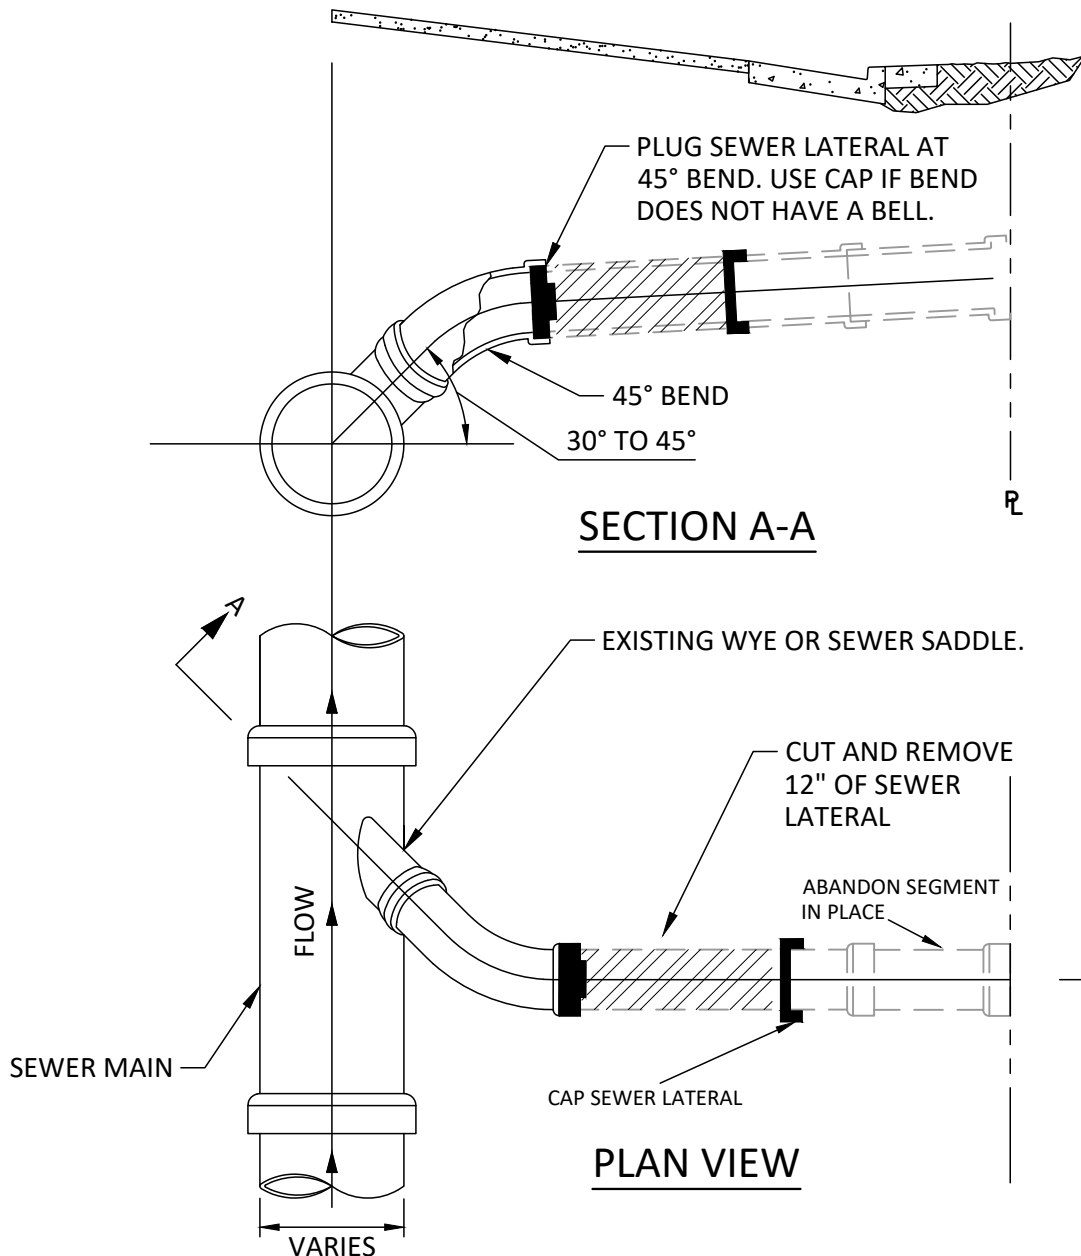

N.T.S.

REVISION	DATE	CITY OF SAN BERNARDINO MUNICIPAL WATER DEPARTMENT	DRAWING NUMBER
		SEWER LATERAL ABANDONMENT	SBMWD
DRAWN BY: JD		APPROVED 	DATE 03/02/2023
SUPERVISED: FL		WARREN HUANG, P.E. RCE 49208	