


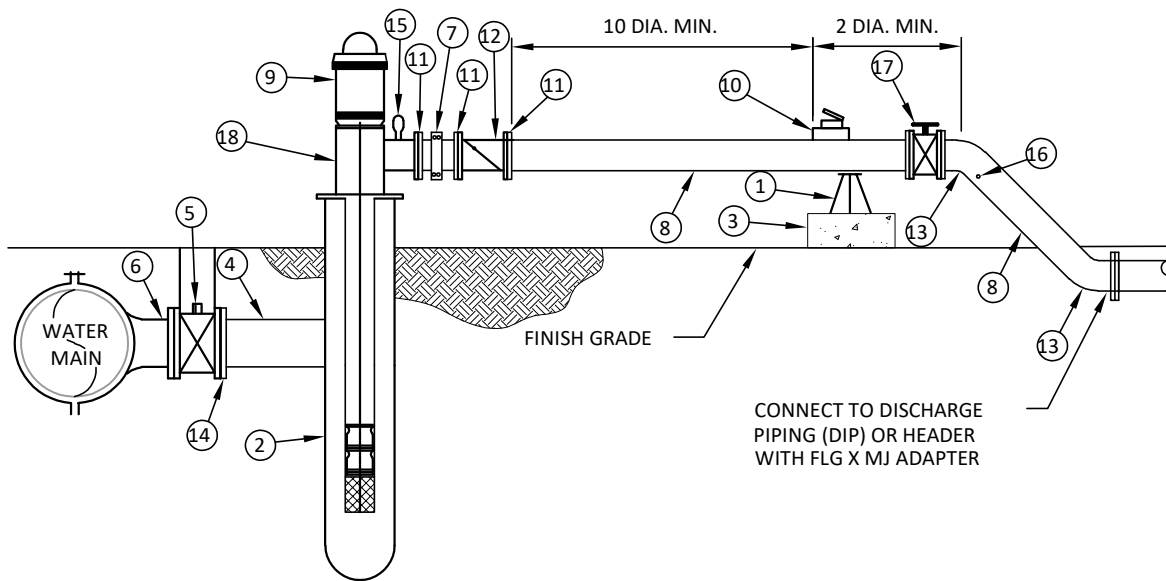

PROFILE VIEW

ITEM QTY	DESCRIPTION
① 1 EA.	UNDER PIPE SUPPORT PER SBMWD STD. DWG. W6.28
② 1 EA.	24" DIA. SCH. 40 STEEL PUMP CAN
③ 1 EA.	REINFORCED CONCRETE BASE
④ 1 EA.	____" SCH. 40 STEEL PIPE
⑤ 1 EA.	____" BUTTERFLY VALVE (FLG) PER SBMWD STD. DWG. W3.2
⑥ 1 EA.	____" X ____" WELD NOZZLE
⑦ 1 EA.	____" VICTAULIC COUPLING FROM THE WATER DEPARTMENT APPROVED LIST W/SCH 40 MILLED END WELD ADAPTORS
⑧ ____	LINEAR FEET SCH. 40 STEEL PIPE
⑨ 1 EA.	PUMP MOTOR
⑩ 1 EA.	WATER METER PER SBMWD STD. DWG. W1.15 APPROVED METER LIST (TOTALIZER TO READ IN 100 CUBIC FEET)
⑪ 3 EA.	____" WELD FLANGE
⑫ 1 EA.	____" CHECK VALVE (EXTERNAL SWING TYPE SPRING AND LEVER) (MUELLER # A-2600-6-02 OR EQUAL)
⑬ 2 EA.	____" 45° STEEL BEND (WELD)
⑭ 1 EA.	____" WELD FLANGE
⑮ 1 EA.	2" COMBINATION AIR/VACUUM RELEASE VALVE
⑯ 1 EA.	3/4" WATER SAMPLING PORT W/STAINLESS STEEL BALL VALVE
⑰ 1 EA.	____" HAND OPERATED BUTTERFLY VALVE
⑱ 1 EA.	SIMFLO PUMPS STEEL DISCHARGE HEAD A-53B/A-36 OR APPROVED EQUAL

REVISION DATE: 1/9/2013

F.D.L.	JAN. 13	SAN BERNARDINO MUNICIPAL WATER DEPARTMENT TYPICAL BOOSTER STATION SECTION	DRAWING NUMBER
D.D.M.	APR. 11		SBMWD
W.B.H.	AUG. 08		W10.2
M.H.L.	MAY 05		
REVISION	DATE		
SCALE: NONE		APPROVED  DATE 07/04/2019 WARREN HUANG, P.E. RCE 49208	