


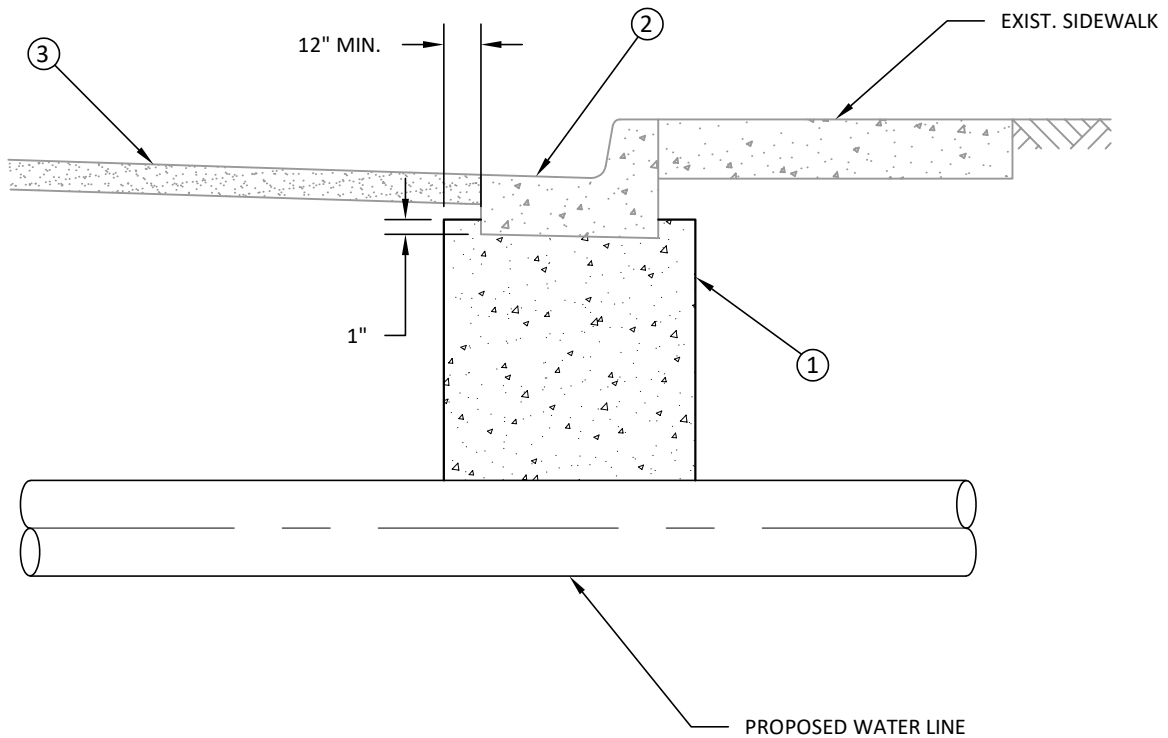

ITEM	DESCRIPTION
①	CONTRACTOR SHALL BACKFILL EXCAVATION UNDER EXISTING CURB & GUTTER WITH 1 SACK SLURRY MIX 1" ABOVE THE BOTTOM OF THE CURB.
②	EXISTING CURB & GUTTER OR CROSS GUTTER TO BE PROTECTED IN PLACE. DAMAGE DUE TO THE CONTRACTOR'S OPERATIONS SHALL BE REPAIRED IN ACCORDANCE WITH THE REQUIREMENT'S OF THE AGENCY HAVING JURISDICTION OVER THE IMPROVEMENT.
③	PAVEMENT REPLACEMENT SHALL BE INSTALLED PER STD. DWG. W5.1.

REVISION DATE: 9/28/2011

		SAN BERNARDINO MUNICIPAL WATER DEPARTMENT		DRAWING NUMBER
		CURB AND GUTTER CROSSING CONFIG. 3" THROUGH 8" PIPELINES		
F.D.L.	SEPT 11			SBMWD
G.B.	MAY 11			
REVISION	DATE			W6.39B
SCALE: NONE		APPROVED		DATE 07/04/2019
		WARREN HUANG, P.E. RCE 49208		